



△	<b>GENERAL NOTES</b>		<b>ELECTRIC SERVICE STANDARD CITY UTILITIES OF SPRINGFIELD MO.</b>			
	<ol style="list-style-type: none"> <li>1. ALL METER BASES SHALL BE LOCATED IN AN OUTSIDE LOCATION ACCESSIBLE TO CITY UTILITIES.</li> <li>2. ALL METER BASES SHALL BE RAIN-TIGHT.</li> <li>3. THE 5TH TERMINAL SHALL BE A BOLT-IN TYPE AND SHALL BE LOCATED IN THE 9:00 POSITION.</li> <li>4. ALL NEUTRAL CONDUCTORS SHALL BE MARKED WHITE OR GRAY (2005 NEC ARTICLES 200.6 &amp; 200.7)</li> <li>5. USE OF THE SERVICE MUST BE PRE-APPROVED BY CITY UTILITIES SERVICE AND POWER QUALITY DEPARTMENT.</li> </ol>	DRAWN BY: <b>G.GUEVARA</b>		SERVICE OVERHEAD METER BASE APPLICATIONS SELF-CONTAINED METERING		
		REV BY: <b>W.BROOKS</b>				
		FILE: <b>SO-GN21</b>				
		APPROVED: <b>08/07/07</b>				
		REVISED:	SHEET OF	STD. NO.		
			1	2	<b>SO-GN2</b>	

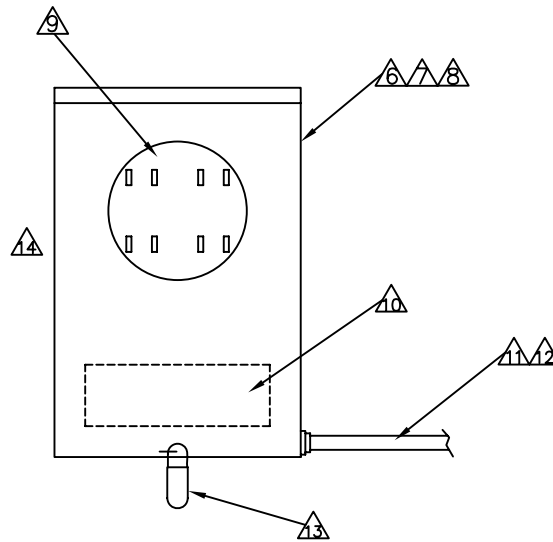

**8-TERMINAL METER BASE**  
 SINGLE PHASE C.T. SERVICE  
 120/240 VOLTS, 3 WIRE  
 120/208 VOLTS, 3 WIRE  
 (MILBANK #UC7444-RL) OR APPROVED EQUIVALENT  
 (FORM-5S METER)

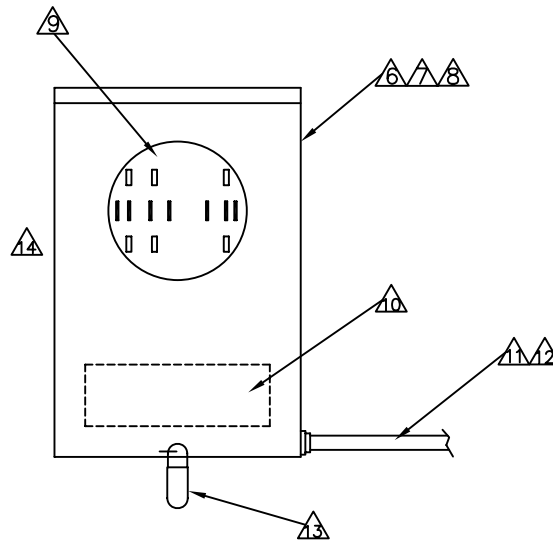

**13-TERMINAL METER BASE**  
 THREE PHASE C.T. SERVICE  
 120/240 VOLTS, 4 WIRE  
 120/208 VOLTS, 4 WIRE  
 (MILBANK #UC7445-RL) OR APPROVED EQUIVALENT  
 (FORM-9S METER)

△	<b>GENERAL NOTES</b>		<b>ELECTRIC SERVICE STANDARD CITY UTILITIES OF SPRINGFIELD MO.</b>	
	<ol style="list-style-type: none"> <li>6. CUSTOMER SHALL FURNISH METER BASE.</li> <li>7. ALL METER BASES SHALL BE RAINTIGHT.</li> <li>8. ALL METER BASES SHALL BE LOCATED IN AN APPROVED OUTSIDE LOCATION ACCESSIBLE TO CITY UTILITIES.</li> <li>9. METER FURNISHED AND INSTALLED BY CITY UTILITIES.</li> <li>10. TEST SWITCHES TO BE FURNISHED &amp; INSTALLED BY CITY UTILITIES.</li> <li>11. THE 1" CONDUIT BETWEEN METER AND C.T. COMPARTMENT FURNISHED &amp; INSTALLED BY CUSTOMER.</li> <li>12. WIRING BETWEEN METER AND C.T.'S FURNISHED AND INSTALLED BY CITY UTILITIES.</li> <li>13. METER SEAL FURNISHED &amp; INSTALLED BY CITY UTILITIES.</li> <li>14. METER SOCKET BONDING AS REQUIRED BY 2005 NEC ARTICLE 250(C).</li> </ol>	DRAWN BY: <b>W.BROOKS</b>	SERVICE OVERHEAD METER BASE APPLICATIONS INSTRUMENT RATED METERING	
REV BY: FILE: <b>SO-GN22</b>	APPROVED: <b>06/05/06</b>	REVISED:		