


**GAS SERVICE
TRENCH CROSS SECTION**

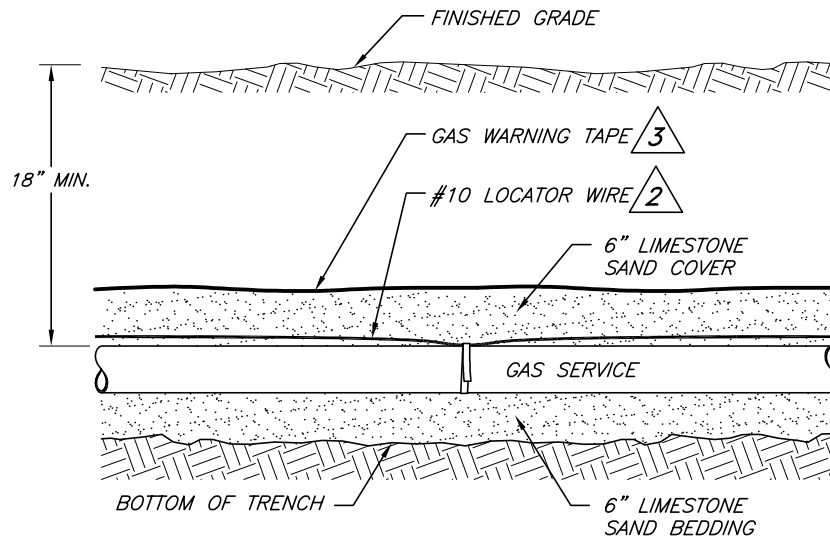

**GAS SERVICE
TRENCH PROFILE**

△	GENERAL NOTES	CONSTRUCTION STANDARD CITY UTILITIES OF SPRINGFIELD, MISSOURI						
1	6" CRUSHED LIMESTONE SAND/BEDDING ON ALL SIDES OF THE GAS SERVICE.	GAS SERVICE TRENCH TYPICAL CROSS SECTION						
2	LOCATOR WIRE (STK # 211571) SHALL BE INSTALLED ON BOTH PLASTIC AND STEEL SERVICES DIRECTLY ABOVE THE GAS PIPE, AND TAPED TO THE PIPE EVERY 20' WITH POLY TAPE (STK # 211522).							
3	NATURAL GAS WARNING TAPE (STK # 213312) SHOULD BE INSTALLED 6" ABOVE THE GAS SERVICE.							
4	MINIMUM TRENCH WIDTH SHALL BE 14" IN SOLID ROCK.							
		<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="font-size: small;">LATEST REV. DATE</td> <td style="font-size: small;">STANDARD NO.</td> <td style="font-size: small;">PAGE:</td> </tr> <tr> <td style="text-align: center;">05/03/2007</td> <td style="text-align: center;">GS-104</td> <td></td> </tr> </table>	LATEST REV. DATE	STANDARD NO.	PAGE:	05/03/2007	GS-104	
LATEST REV. DATE	STANDARD NO.	PAGE:						
05/03/2007	GS-104							