


**GAS/TELEPHONE
JOINT TRENCH CROSS SECTION**

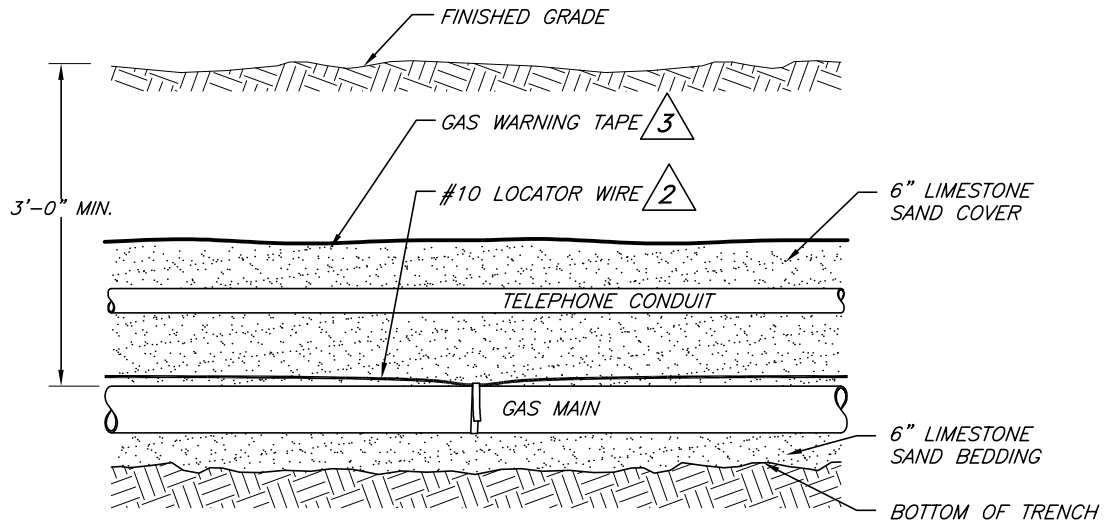

**GAS/TELEPHONE
JOINT TRENCH PROFILE**

GENERAL NOTES		CONSTRUCTION STANDARD CITY UTILITIES OF SPRINGFIELD, MISSOURI
1	6" CRUSHED LIMESTONE SAND/BEDDING ON ALL SIDES OF THE GAS PIPE.	
2	LOCATOR WIRE (STK # 211571) SHALL BE INSTALLED ON BOTH PLASTIC AND STEEL PIPE DIRECTLY ABOVE THE GAS PIPE, AND TAPED TO THE PIPE EVERY 20' WITH POLY TAPE (STK # 211522).	
3	NATURAL GAS WARNING TAPE (STK # 213312) SHOULD BE INSTALLED 6" ABOVE THE GAS PIPE.	
4	MINIMUM TRENCH WIDTH SHALL BE 14" IN SOLID ROCK.	
		GAS & TELEPHONE CABLE JOINT TRENCH TYPICAL CROSS SECTION
LATEST REV. DATE		STANDARD NO.
05/03/2007		GS-109
		PAGE: