


CONTACT CU CORROSION CONTROL VEHICLE #156/167 WHEN WELDED STEEL GAS MAIN AND/OR WELDED STEEL GAS SERVICES ARE EXPOSED.

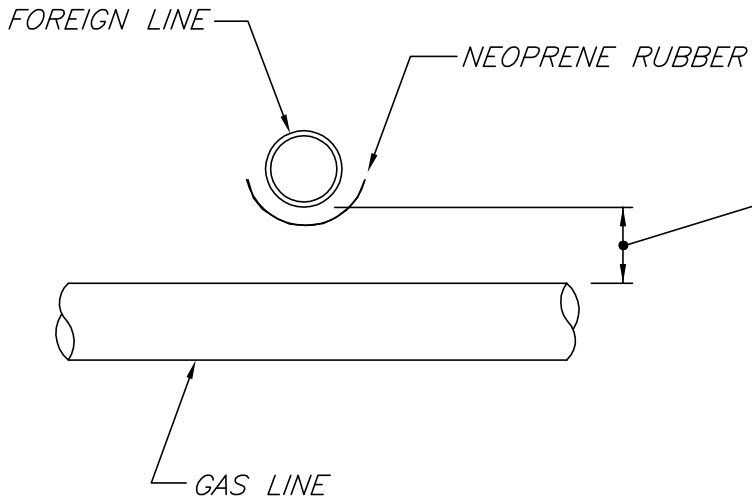

- DISTANCE BETWEEN LINES
1. IF CLOSER THAN ONE INCH OR TOUCHING, MASTIC & WRAP & INSTALL 1/4" NEOPRENE RUBBER BETWEEN PIPES. MEASURE LOCATION & NOTIFY ENGINEERING.
  2. IF THE DISTANCE BETWEEN PIPES IS BETWEEN 1" AND 6", INSTALL 1/4" NEOPRENE RUBBER
  3. IF THE DISTANCE IS GREATER THAN 6" MASTIC & WRAP ONLY

NOTE:  
STANDARD SEPARATION IS 18"

△	<b>GENERAL NOTES</b>		<b>CONSTRUCTION STANDARD CITY UTILITIES OF SPRINGFIELD, MISSOURI</b>		
			<b>MAIN CROSSING REWORK</b>		
	LATEST REV. DATE	STANDARD NO.	PAGE:		
	05/21/97	GS-180			