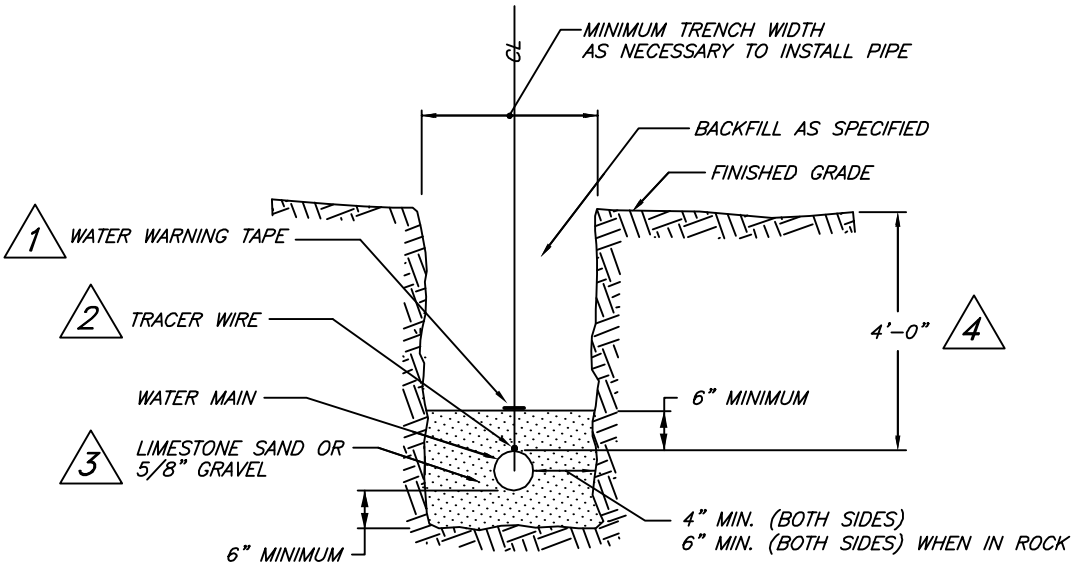

WATER MAIN CROSS SECTION

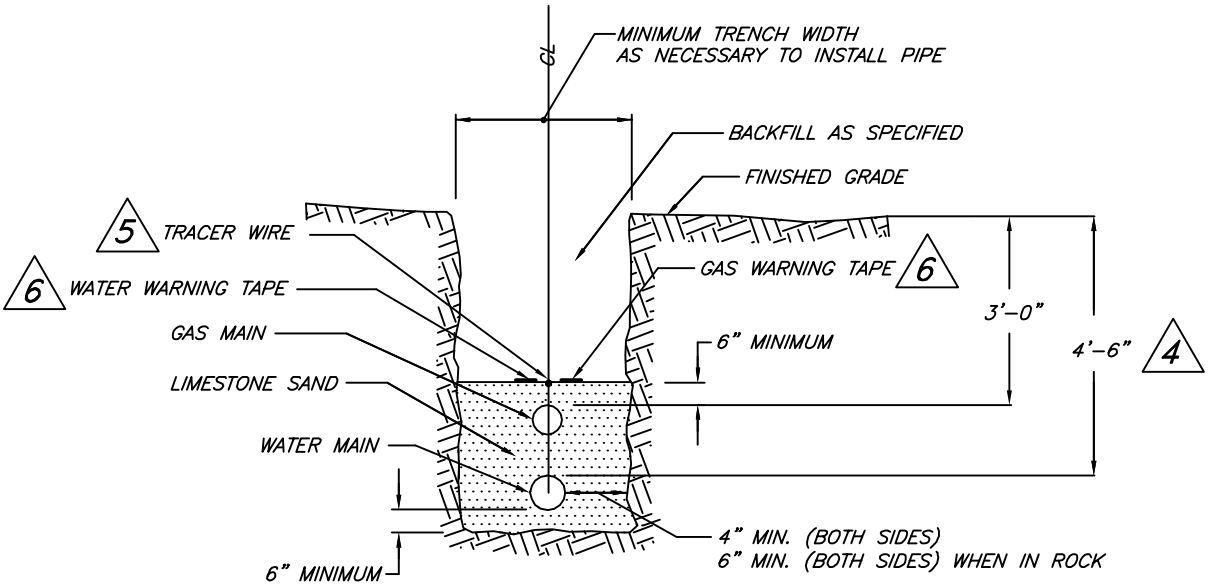

JOINT TRENCH CROSS SECTION

△	GENERAL NOTES
1.	WATER WARNING TAPE SHALL BE PLACED 6" MINIMUM ABOVE WATER MAIN.
2.	TRACER WIRE SHALL BE TAPED TO WATER MAIN EVERY 20'.
3.	WHEN WATER MAIN IS HDPE PIPE, BEDDING SHALL BE LIMESTONE SAND.
4.	MAXIMUM COVER 6'-0" EXCEPT WHERE SPECIFIED BY ENGINEER.
5.	TRACER WIRE SHALL BE INSTALLED 6" MINIMUM ABOVE GAS MAIN.
6.	GAS WARNING TAPE AND WATER WARNING TAPE SHALL BE PLACED SIDE-BY-SIDE, 6" MINIMUM ABOVE GAS MAIN.

CONSTRUCTION STANDARD
CITY UTILITIES
OF SPRINGFIELD, MISSOURI

TYPICAL TRENCH
CROSS SECTION

LATEST REV. DATE	STANDARD NO.	PAGE:
8/19/2011	WS-101	