


JOINT TRENCH CROSS SECTION

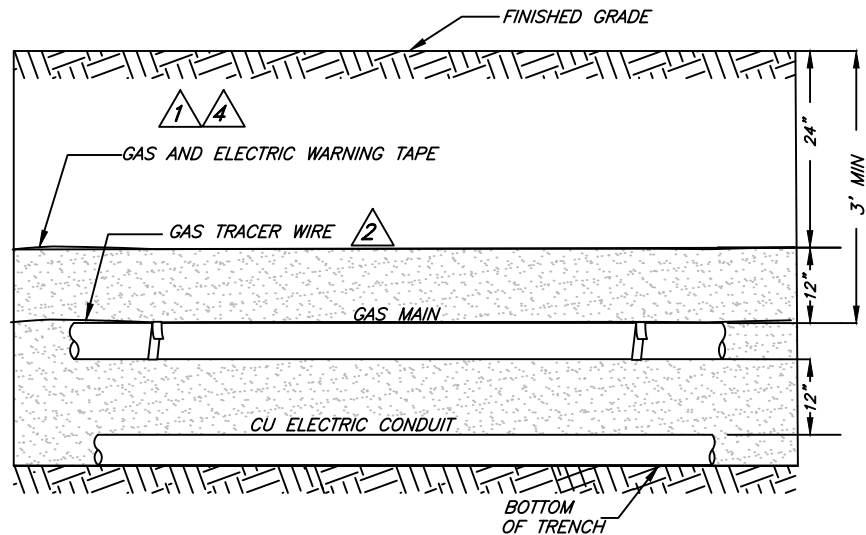

△	GENERAL NOTES	CONSTRUCTION STANDARD CITY UTILITIES OF SPRINGFIELD, MISSOURI
1	GAS WARNING TAPE SHALL BE PLACED DIRECTLY OVER AND 12" ABOVE THE GAS MAIN.	TYPICAL TRENCH CROSS SECTION JOINT TRENCH GAS & CU ELECTRIC
2	GAS TRACER WIRE SHALL BE TAPED TO GAS MAIN.	
3	GAS MAIN TO BE PLACED ON CENTERLINE OF TRENCH.	
4	ELECTRIC WARNING TAPE SHALL BE DIRECTLY OVER ELECTRIC LINE AND NEXT TO GAS WARNING TAPE (12" ABOVE THE GAS MAIN).	
5	GAS MAIN IS NOT TO BE INSTALLED UNDERNEATH ELECTRICAL EQUIPMENT (TRANSFORMERS, JUNCTION CABINETS, PEDESTALS, ETC.), SEE GS-231.	
		LATEST REV. DATE: 09/22/2022 STANDARD NO.: GS-105 PAGE: