


DIGGING PERPENDICULAR TO PIPELINE



DIGGING PARALLEL TO PIPELINE

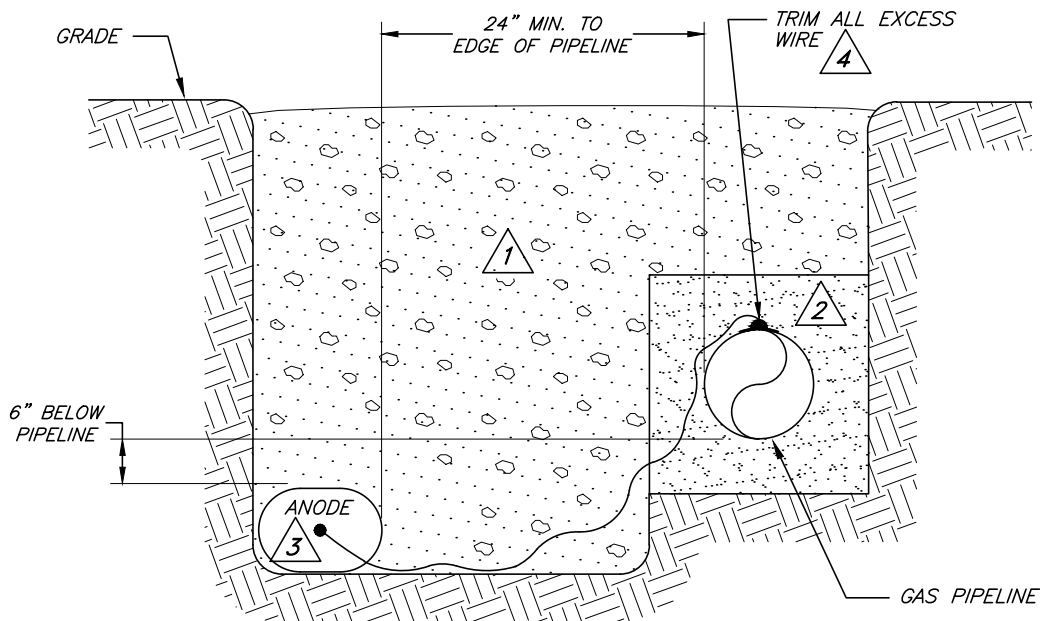

#### GENERAL NOTES

- 1 SOIL BACKFILL (ROCK, GRAVEL, AND SAND ARE NOT ACCEPTABLE AROUND THE ANODE).
- 2 SAND BACKFILL. 6" MINIMUM ON ALL SIDES OF THE PIPE.
- 3 ANODE SIZE AS SPECIFIED ON THE CONSTRUCTION DRAWING:  
 17 LB. (STOCK # 202015)  
 9 LB. (STOCK # 202010)  
 5 LB. (STOCK # 202005)  
 1/2 LB. (STOCK # 202000)
- 4 FOR THERMITE WELDING PARTS, AND COATING REPAIR PROCEDURE, SEE GS-415.
- 5 FOR TEST STATION WIRING CONFIGURATIONS, SEE GS-410.

CONSTRUCTION STANDARD  
CITY UTILITIES OF  
SPRINGFIELD, MISSOURI

ANODE INSTALLATION  
ON STEEL GAS PIPELINE

LATEST REV. DATE	STANDARD NO.	PAGE:
05/03/2007	GS-400	