


APPLICATION GUIDE			
DESCRIPTION	VOLTAGE		
	OH/UG 1 $\phi$ /3 $\phi$ 120/208 V	OH 1 $\phi$ /3 $\phi$ 120/240 V	OH 3 $\phi$ 277/480V
COMMERCIAL	X	X	X

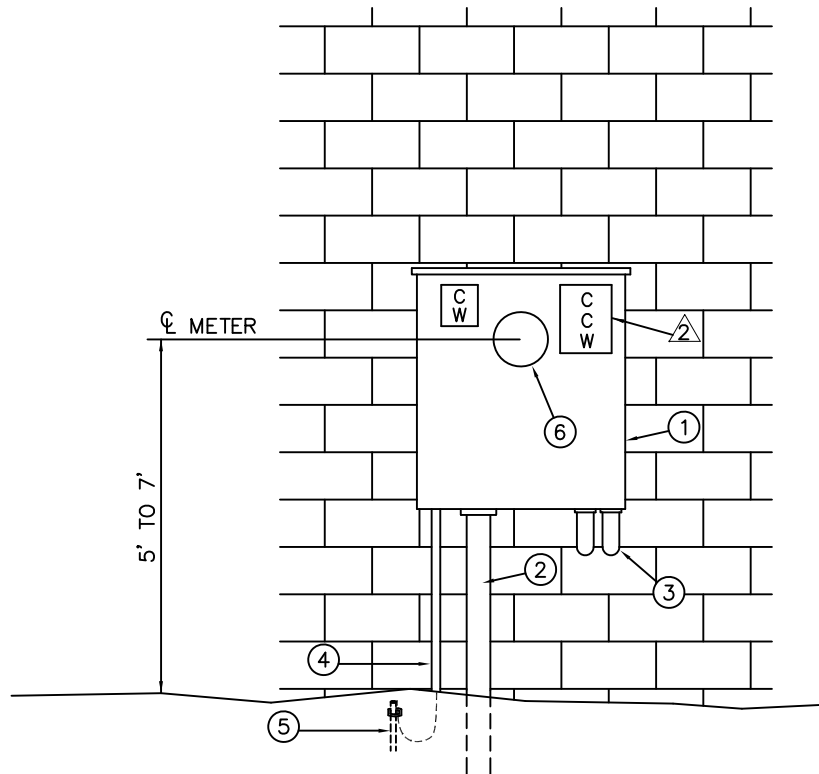

**MATERIAL LIST**

QTY.	DESCRIPTION	STOCK NO.	QTY.	DESCRIPTION	STOCK NO.
<b>FURNISHED AND INSTALLED BY CUSTOMER</b>			<b>FURNISHED BY CITY UTILITIES</b>		
1.	1 METER ENCLOSURE (RAINTIGHT) (FOR BOLT-IN 7 TERMINAL METER)		6.	1 7 TERMINAL BOLT-IN METER	
2.	AS REQD SERVICE LATERAL CONDUIT(S) AND CONDUCTORS - $\triangle$				
3.	AS REQD LOAD SIDE CONDUIT(S) AND CONDUCTORS TO CUSTOMER'S DISCONNECT SWITCH				
4.	AS REQD GROUNDING ELECTRODE CONDUCTOR - $\triangle$				
5.	AS REQD GROUNDING ELECTRODE - $\triangle$				

• FURNISHED BY CITY UTILITIES  
INSTALLED BY CUSTOMER  
PICK UP AT 825 N. BELCREST

$\triangle$ GENERAL NOTES		<b>ELECTRIC SERVICE STANDARD CITY UTILITIES OF SPRINGFIELD MO.</b>	
1.	CUSTOMER TO VERIFY SIZE AND LOCATION OF ALL SERVICE EQUIPMENT WITH CITY UTILITIES AND THE APPROPRIATE INSPECTION AUTHORITIES BEFORE BEGINNING WORK.	DRAWN BY: A.C.	SERVICE UNDERGROUND COMBINATION 1 $\phi$ /3 $\phi$ 400 AMP SELF CONTAINED
2.	CHECK AND TAG SERVICE TO INDICATE CLOCKWISE (CW) OR COUNTER CLOCKWISE (CCW) ROTATION AT THE METER.	REV BY: K.DENTON	
3.	SEE SU-GN3 FOR CONNECTION DETAIL WHEN INSTALLING A 120/240 VOLT 4-WIRE COMBINATION SERVICE.	FILE: SU-3-400	
4.	CHECK WITH LOCAL INSPECTION AUTHORITY TO VERIFY REQUIREMENTS FOR GROUNDING ELECTRODE CONDUCTOR SIZE AND TYPE OF GROUNDING ELECTRODE TO BE USED. ALL GROUNDING TO MEET 2017 NEC ARTICLE 250.	APPROVED: 10/29/14	REVISD: 03/19/18
			SHEET OF 1 1
			STD. NO. <b>SU-3-400</b>