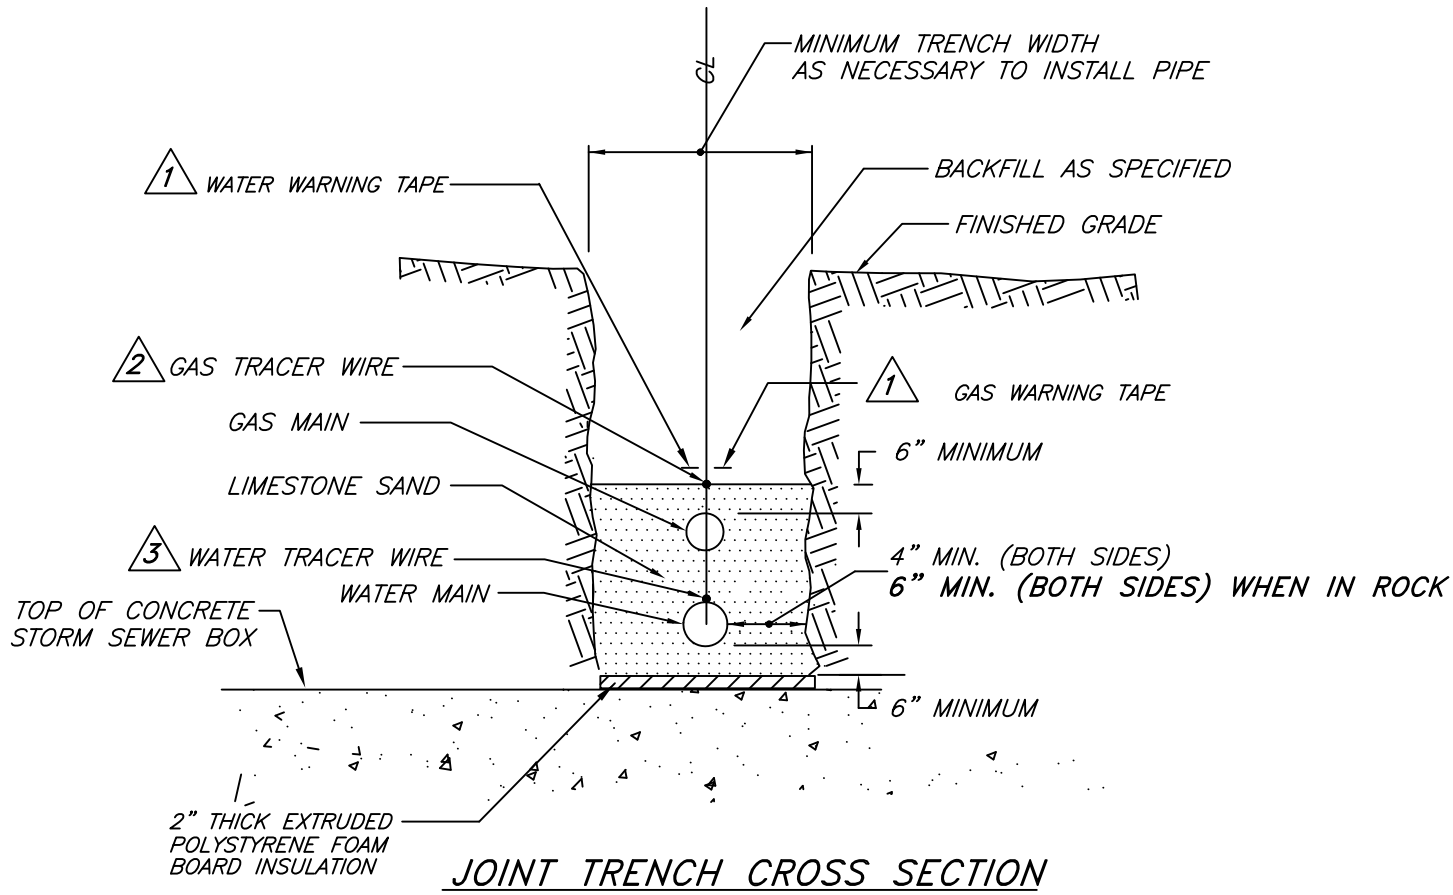

JOINT TRENCH CROSS SECTION

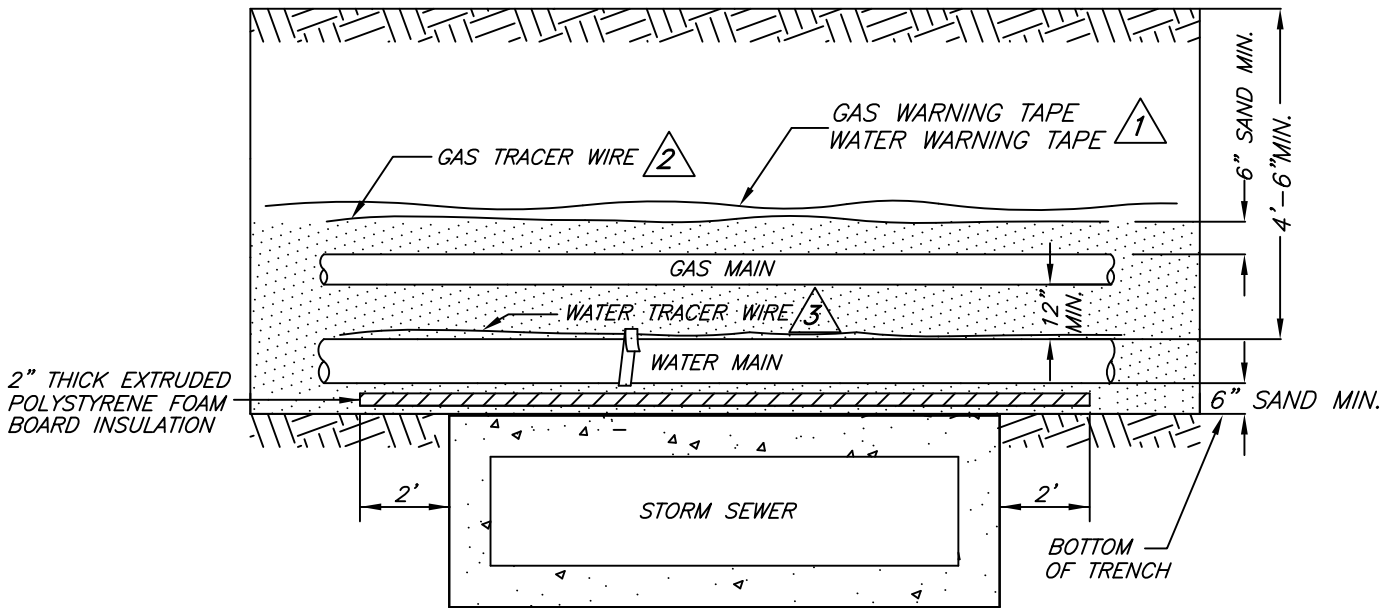

GENERAL NOTES

1. GAS WARNING TAPE AND WATER WARNING TAPE SHALL BE PLACED SIDE-BY-SIDE 6" MINIMUM ABOVE GAS MAIN
2. TRACER WIRE SHALL BE SIX INCHES ABOVE GAS MAIN.
3. TRACER WIRE SHALL BE INSTALLED DIRECTLY ABOVE THE WATER MAIN AND TAPED EVERY 20' WITH POLY TAPE (STK # 111208).

CONSTRUCTION STANDARD
CITY UTILITIES
OF SPRINGFIELD, MISSOURI

TYPICAL STORM SEWER
BOX CROSS SECTION
BOTTOM INSULATED
CROSSING JOINT TRENCH

LATEST REV. DATE	STANDARD NO.	PAGE:
04/01/2013	WS-102	